


Cod: FLE.054.TER.EC.D.V.01.20	
Dis: Pistillo S.	Data: 05/01/20
DESCRIZIONE MORSETTIERA	
L	Alimentazione L 230V (marrone)
N	Alimentazione N 230V (blu)
10	Segnale ventilatore 0-10Vcc (rosso)
0	Segnale ventilatore GND (nero)
N'	Comune valvola N 230V (blu)
H	Consenso valvola caldo L 230V (marrone)
C	Consenso valvola freddo L 230V (marrone)

TERMINAL DESCRIPTION	
L	Power supply L 230V (brown)
N	Power supply N 230V (blue)
10	Fan signal 0-10Vcc (red)
0	Fan signal GND (black)
N'	Common valve N 230V (blue)
H	Heat valve consent L 230V (brown)
C	Cool valve consent L 230V (brown)

COLLEGAMENTO FLE054+VAL+TER.EC.DIG

FLE054+VAL+TER.EC.DIG CONNECTION

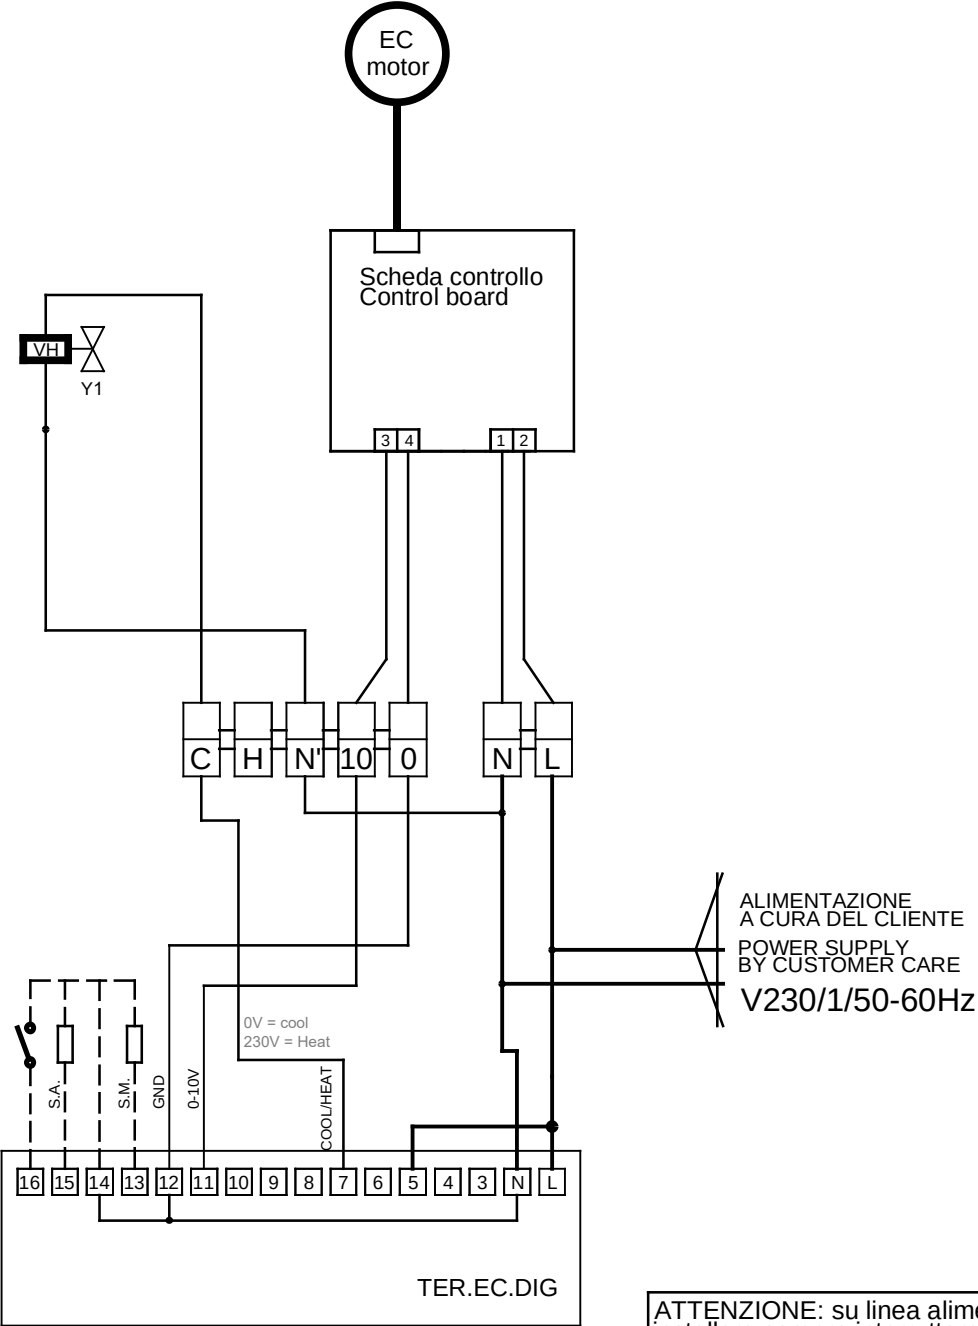

ATTENZIONE: su linea alimentazione elettrica installare sempre interruttore differenziale e/o quanto previsto dalle normative nazionali.

ATTENTION: on the line of power supply always install differential switch and/or as required by national regulations